Building Chilled Water

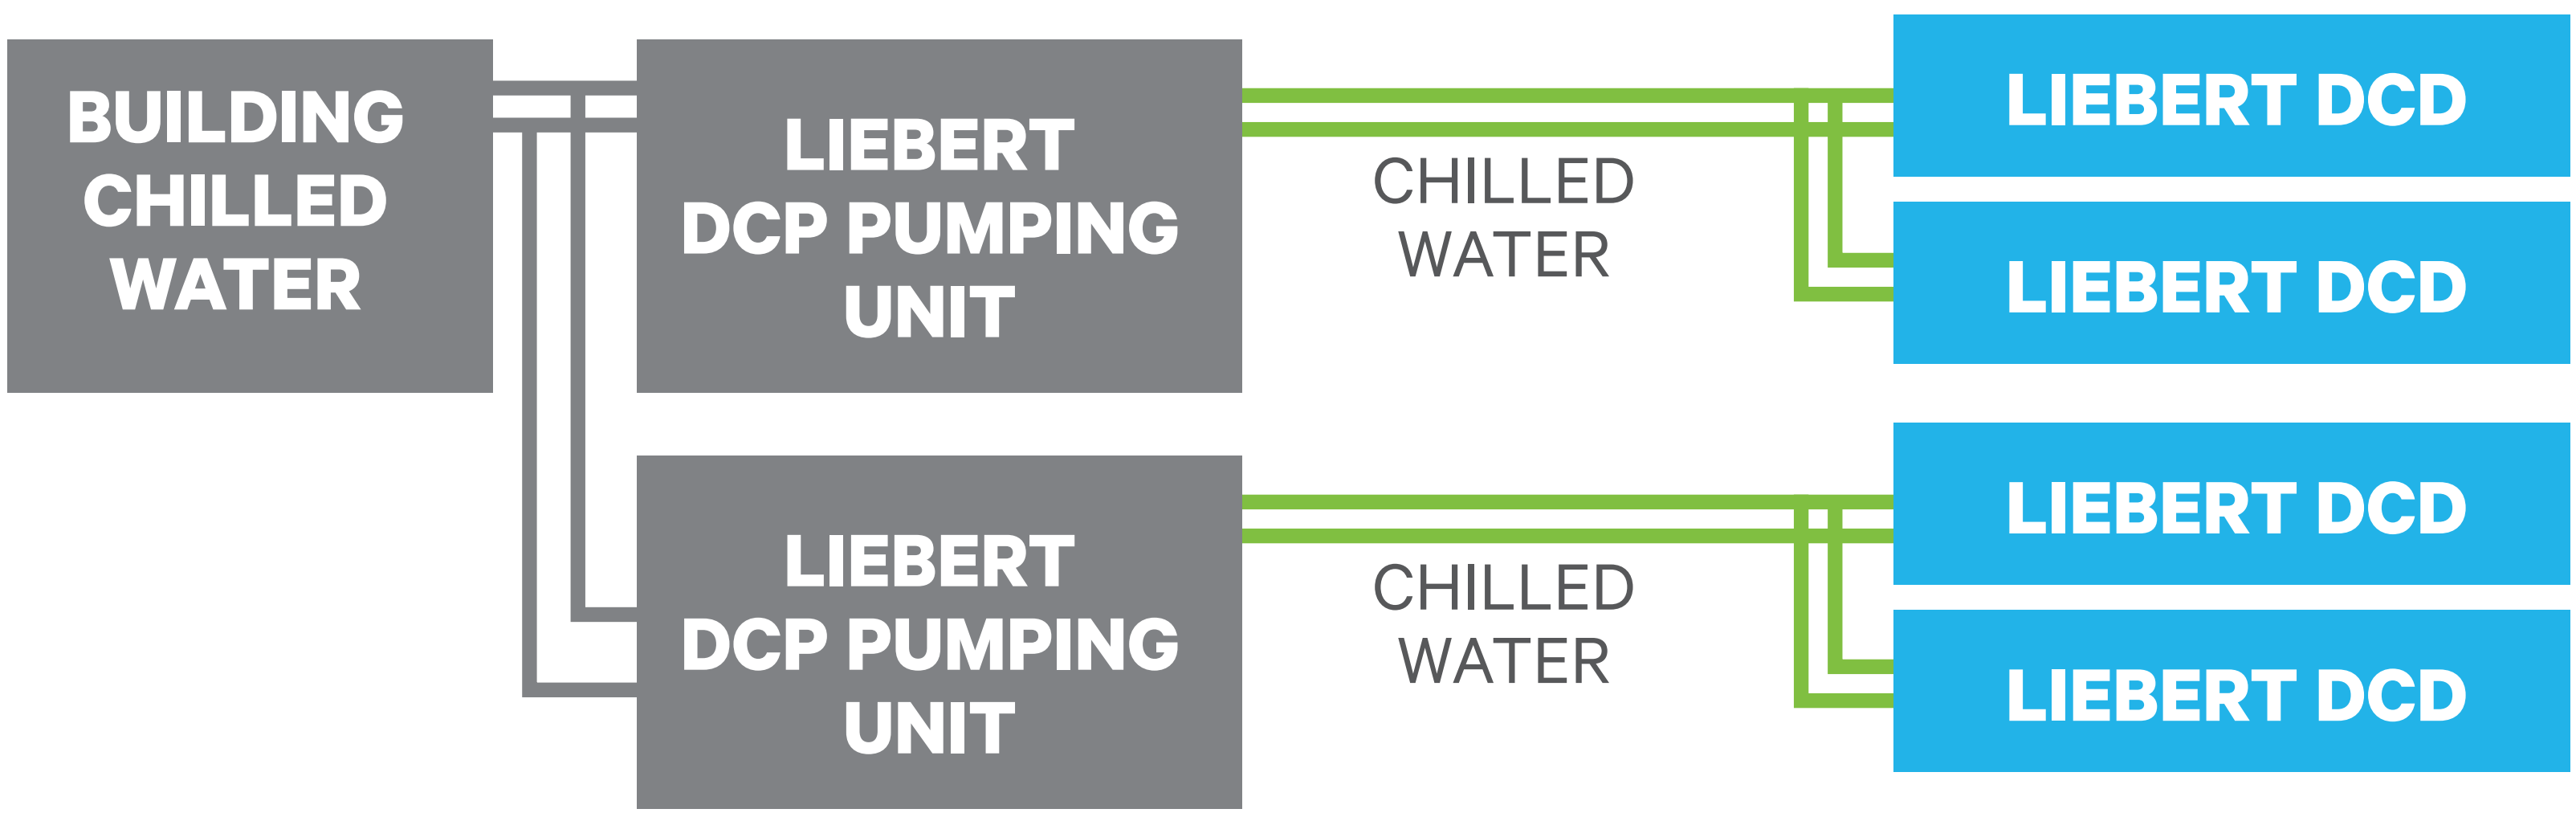

Normalized Annual Energy Usage