



**DISCONTINUED  
PRODUCT**

**POWER AVAILABILITY**

# **PowerSure™ PSA**

**USER MANUAL**



**350-1000 VA  
120V**



**DISCONTINUED  
PRODUCT**

---

# TABLE OF CONTENTS

<b>IMPORTANT SAFETY INSTRUCTIONS</b> . . . . .	<b>1</b>
<b>INTRODUCTION &amp; SYSTEM DESCRIPTION</b> . . . . .	<b>4</b>
Front View of UPS . . . . .	5
Rear View of UPS . . . . .	6
<b>MAJOR COMPONENTS</b> . . . . .	<b>7</b>
Transient Voltage Surge Suppression (TVSS) & EMI/RFI Filters . . . . .	7
Automatic Voltage Regulator . . . . .	7
Bi-Directional Converter . . . . .	7
Battery . . . . .	7
<b>WHAT'S INCLUDED</b> . . . . .	<b>8</b>
<b>INSTALLATION</b> . . . . .	<b>9</b>
<b>CONTROLS AND INDICATORS</b> . . . . .	<b>11</b>
ON/OFF/Alarm Silence Button . . . . .	11
Status Indicators: Utility, Battery, Fault . . . . .	12
Utility Indicator (Green/Amber) . . . . .	12
Battery Indicator (Green/Amber) . . . . .	12
Fault Indicator (Red/Green) . . . . .	12
Location and Status of Indicators . . . . .	12
Site Wiring Fault Indicator (Red) . . . . .	13
Transfer Voltage Selectors (DIP Switches) . . . . .	13
<b>MODES OF OPERATION</b> . . . . .	<b>14</b>
Normal Mode . . . . .	14
Buck/Boost Mode . . . . .	14
Battery Mode . . . . .	15
<b>COMMUNICATIONS</b> . . . . .	<b>16</b>
DB-9 Connector . . . . .	16
Remote Shutdown Via the DB-9 Connector . . . . .	17
Shutdown Via Pins 5 & 6 . . . . .	17
Shutdown Via Pins 4 & 5 . . . . .	17
USB Interface Port . . . . .	17
Data Line Protection Connectors . . . . .	17

---

<b>MAINTENANCE</b> . . . . .	<b>18</b>
Cleaning the UPS . . . . .	18
Maintaining Batteries . . . . .	18
Battery Replacement . . . . .	18
Battery Replacement Procedure . . . . .	19
<b>TROUBLESHOOTING</b> . . . . .	<b>20</b>
Guide to Status Indicators . . . . .	20
Troubleshooting Chart . . . . .	21
<b>SPECIFICATIONS</b> . . . . .	<b>22</b>
Battery Run Times . . . . .	23
Product Warranty Registration . . . . .	23

---

## IMPORTANT SAFETY INSTRUCTIONS

---

### SAVE THESE INSTRUCTIONS

This manual contains important safety instructions that should be followed during the installation and maintenance of the Uninterruptible Power System (UPS) and its batteries. Please read this manual thoroughly before attempting to install or operate this UPS.

Read all safety, installation, and operating instructions before operating the UPS. Adhere to all warnings on the unit and in this manual. Follow all operating and user instructions.

This equipment is designed for Commercial, Industrial or Residential use. Liebert Corporation neither recommends nor knowingly sells this product for use in life support applications or with other designated critical devices.

This equipment can be installed and operated by individuals without previous training.



### WARNING

#### SAFETY PRECAUTIONS

- To prevent the risk of fire or electric shock, install the UPS in a temperature and humidity controlled room, free of conductive contaminants, moisture, flammable liquids, gases and corrosive substances.
- Operate the UPS only from a properly grounded (earthed) 120VAC, 60Hz AC supply.
- To reduce the risk of electric shock, do not remove the cover, as it has no user-serviceable parts inside except the internal battery pack. Some components are live, even when AC power is disconnected. For service, contact a qualified technician.



## CAUTION

Although your UPS has been designed and manufactured to assure personal safety, improper use may result in electrical shock or fire. To ensure safety, please observe the following rules:

- Turn off and unplug your UPS before cleaning. Do not use liquid or aerosol cleaners. A dry cloth is recommended to remove dust from the surface of your UPS.
- Do not install or operate your UPS in or near water.
- Do not place your UPS on an unstable cart, stand or table.
- Do not place your UPS in direct sunlight or near heat emitting sources.
- Never block or insert any objects into the ventilation holes or other openings of the UPS. Keep all vents free of dust accumulation that could restrict airflow.
- Do not place the UPS power cord in any area where it may be damaged by heavy objects.
- Placing magnetic storage on the top of the UPS may result in data corruption.



## CAUTION

If your UPS demonstrates any of the following conditions, turn off and unplug your UPS from the outlet and contact your local dealer, Liebert representative, or Liebert Worldwide Support Group.

- The power cord is damaged.
- Liquid has been spilled on the UPS.
- The circuit breaker or fuse opens frequently.
- The UPS does not operate in accordance with the user manual.

Provided are a Liebert MultiLink cable and a USB cable for connection to a computer. Do not use the Liebert MultiLink cable for other applications. Store in a safe place if not required at this time.

When using the communication features on this UPS, ensure the cabling connected to the DB-9 or UPS communications ports are kept separated from the power leads to the UPS input and output.

---

**CONDITIONS OF USE:** The input receptacle must be within 6 feet (1.8 meters) of the UPS.

Your UPS provides conditioned power to connected equipment. Maximum load must not exceed that shown on UPS rating label. If uncertain, consult your local dealer, Liebert representative or the Liebert Worldwide Support Group.

The equipment can be installed and operated by individuals without previous training.



## **CAUTION**

### **BATTERY HANDLING PRECAUTIONS**

Servicing of batteries should be performed or supervised by personnel knowledgeable of batteries and required precautions. Keep unauthorized personnel away from the batteries.

A battery can present a risk of electrical shock and high short-circuit current. The following precautions should be observed when working on batteries:

- Remove watches, rings, and other metal objects.
- Use tools with insulated handles.
- Do not dispose battery or batteries in a fire. The battery may explode.
- Do not open or mutilate the battery or batteries. Released electrolyte is harmful to skin and eyes. It may be toxic.
- When replacing the battery, use same number and type of battery as the suitable recommended type of battery listed in specification table in back of this manual.
- Handle, transport and recycle batteries in accordance with local regulations.

---

## INTRODUCTION & SYSTEM DESCRIPTION

---

Congratulations on your choice of the Liebert PowerSure™ PSA Uninterruptible Power System (UPS). It provides filtered AC power to sensitive electronic equipment and other critical loads.

The PowerSure PSA is a line-interactive UPS designed for an office environment. It provides perfect power protection for PCs, point-of-sale systems, network and similar electronic equipment. It offers a configurable input voltage window allowing you to precisely match your equipment's input power. Three communications options are available: serial connection, contact closure and USB. The PowerSure PSA is available in four (4) sizes: 350, 500, 650 and 1000VA at 120 VAC and 230 VAC.

PowerSure PSA models are available for 120 VAC and 230 VAC supply voltages and loads. Please verify that this model matches your AC Utility and load voltage requirements.



### NOTE

*This device complies with part 15 of the FCC Rules.*

*Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.*

*This equipment uses, generates and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference with radio communications. However, there is no guarantee that interference will not occur in a particular installation.*

*If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:*

- *Reorient or relocate the receiving antenna.*
- *Increase the separation between the UPS and the receiver.*
- *Connect the UPS into an outlet on a circuit different from the one on which the receiver is connected.*

---


# Front View of UPS




\* For details, see  
Controls and  
Indicators section

# Rear View of UPS

## 350 & 500 VA Models

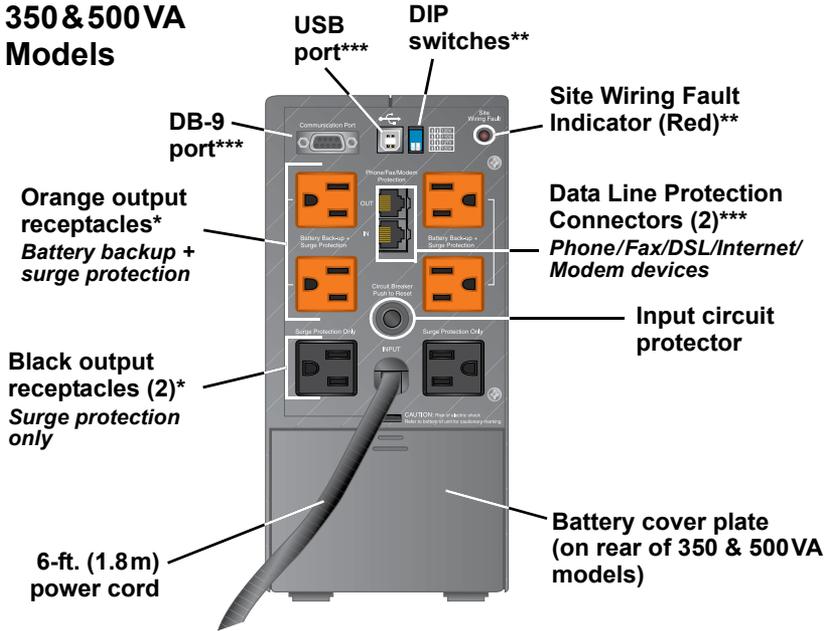


## 650 & 1000 VA Models

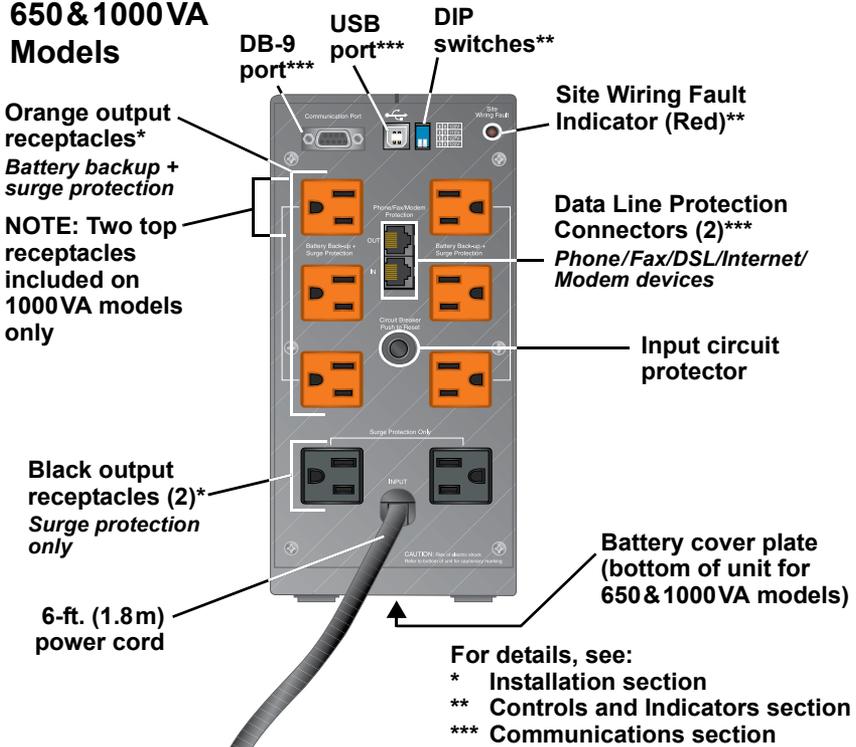

---

## MAJOR COMPONENTS

---

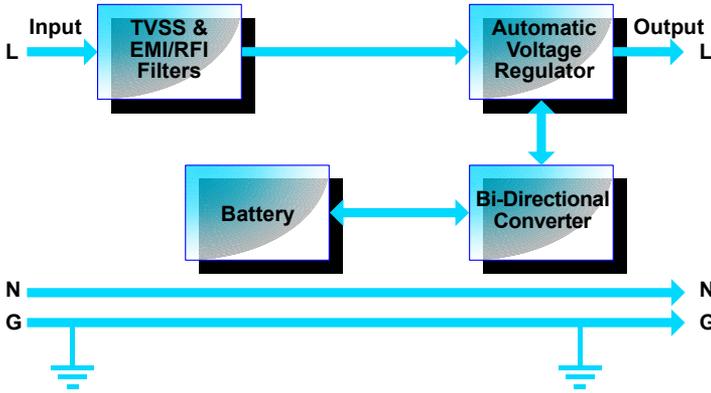

### Transient Voltage Surge Suppression (TVSS) & EMI/RFI Filters

These UPS components provide surge protection and filter electromagnetic interference (EMI) and radio frequency interference (RFI). They minimize surges or interference present in the utility line and keep the sensitive equipment protected.

### Automatic Voltage Regulator

The Automatic Voltage Regulator (AVR) protects connected equipment from power spikes and other abnormalities by raising an undervoltage (*boost*) and lowering an overvoltage (*buck*) as needed. This keeps the UPS output voltage within the connected equipment's tolerance and accommodates wide utility voltage fluctuations without utilizing the batteries.

### Bi-Directional Converter

In normal operation, the Bi-Directional Converter changes utility AC power into regulated DC power to “float charge” the battery system. This converter is continuously charging the battery whenever the UPS is plugged into a power outlet and utility power is within acceptable limits—even if the UPS is turned OFF.

When utility power fails, the Bi-Directional Converter draws energy from the battery and inverts it into a regulated stepped sinewave supplying power for equipment connected to the orange receptacles.

### Battery

The PowerSure PSA utilizes valve-regulated, nonspillable, lead acid batteries. To optimize battery life, operate the UPS in an ambient temperature of 68° - 77°F (20° - 25°C).

---

## WHAT'S INCLUDED

---

The PowerSure PSA is shipped with the following items:

- PowerSure PSA user manual
- MultiLink™ software CD
- MultiLink serial cable (M3LS9P9S), 10-ft. (3 m)
- USB cable, 6-ft. (1.8 m)
- RJ-11 cord, 7-ft. (2.1 m)
- Warranty card



**PowerSure  
PSA**



**MultiLink  
software CD**



**MultiLink  
serial cable  
(M3LS9P9S)  
10 ft. (3m)**



**USB cable  
6 ft. (1.8m)**



**RJ-11 cord  
7 ft. (2.1 m)**

# INSTALLATION


This UPS is designed for data processing equipment. Maximum load must not exceed that shown on the UPS rating label. Do not connect equipment that could overload the UPS or draw half-wave current from the UPS, for example: electric drills, vacuum cleaners, laser printers or hair dryers. Your total load earth leakage current must not exceed 3.5 mA. Most data processing equipment meets this requirement if you use no more than two pieces of equipment. If uncertain about your load, consult your local dealer, Liebert representative, or Liebert Worldwide Support Group.

1. Visually inspect the UPS for freight damage. Report damage to the carrier and your local dealer, Liebert representative or the Liebert Worldwide Support Group.
2. Decide where to place the PowerSure PSA. Find a location that is near an easily accessible utility outlet. Install the UPS indoors in a controlled environment, where it cannot be accidentally turned off. Place it in an area of unrestricted airflow around the unit, away from water, flammable liquids, gases, corrosives, and conductive contaminants. Maintain a minimum clearance of 4 inches (100mm) on each side of the UPS. Maintain an ambient temperature range of 32°F to 104°F (0°C to 40°C).



## NOTE

*UPS operation in temperatures above 77°F (25°C) reduces battery life.*

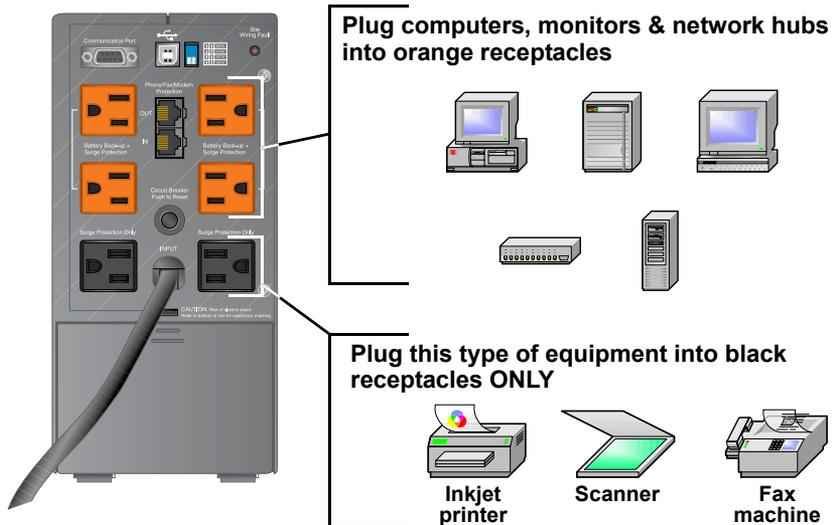


3. Plug the PowerSure PSA's attached 6-ft. (1.8m) power cord into an AC outlet. Check that the Site Wiring Fault Indicator on the rear is not illuminated. If it is lit, refer to the **Troubleshooting** section.

4. Plug any computers and monitors into the orange battery backed up receptacles.

Other office machines that do not exceed the capacity of the UPS—ink-jet printers, scanners and fax machines—may be plugged into either of the two (2) black receptacles, which provide surge protection only.

5. Connect Phone/Fax/DSL/Internet/Modem devices to data line connectors.

#### Serial port for MultiLink cable connection

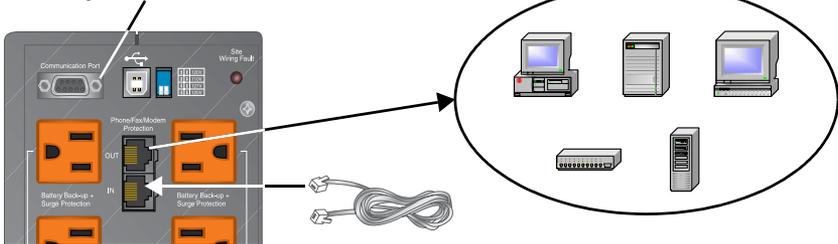

6. Press and release the ON/OFF/Alarm Silence button to turn on the UPS. The UPS will beep and the Utility Indicator will illuminate (green).
7. Turn on connected equipment.
8. Communication options (see **Communications** section for details):

#### Option 1—Serial Communications

Serial communications provides parametric data, for example, input voltage and battery voltage.

- a. Connect Multilink serial cable included with the UPS to communications port.
- b. Install the MultiLink software—the software and installation instructions, as well as the user manual, are on the CD included in the PowerSure PSA package.

#### Option 2—Contact Closure Communications

Contact Closure communications provides on-battery and low-battery signals for orderly shutdown.

- a. Refer to the MultiLink user manual for instructions on making your own contact closure cable.
- b. Install the MultiLink software—the software and installation instructions, as well as the user manual, are on the CD included in the PowerSure PSA package.

#### Option 3—USB Communications

- a. Connect USB cable provided with the UPS to the USB ports on the PSA and your computer. The PSA will work automatically with your built-in power management software on Windows XP and 2000 and Mac OS 10.2 or later (see **USB Interface Port** section for details).

---

## CONTROLS AND INDICATORS

---

### ON/OFF/Alarm Silence Button



This button controls output power to the connected load and has three functions:

- ON
- OFF
- Alarm Silence



**ON/OFF/Alarm Silence**

**ON** When the UPS is off, pressing and releasing the main ON/OFF button will start the UPS, and an audible alarm sounds briefly. The UPS is capable of starting on battery (*battery start*).

**OFF** When the UPS is on (in either Normal or Battery mode), pressing the main ON/OFF button for **more than two (2) seconds** will shut down the UPS. An audible alarm sounds briefly.

**Alarm Silence** When a UPS alarm is active, pressing and releasing the main ON/OFF button will silence the active audible alarm, whether utility power is present or not. Once the alarm silence function has been activated, all active audible alarms—except for low battery, overload, or over-temperature conditions—will remain silenced until a new alarm condition is detected.



#### **NOTE**

*Do not hold ON/OFF button down for **more than 2 seconds** or the UPS will shut down.*

---

## Status Indicators: Utility, Battery, Fault

There are three (3) status indicators on the front of the UPS (Utility, Battery and Fault), as shown in the diagram below. Each indicator illuminates to specify the status of the UPS (see **Troubleshooting** section for details).

### Utility Indicator (Green/Amber)

The Utility Indicator illuminates when the UPS is operating and supplying power to connected loads: green indicates Normal mode, amber denotes Buck/Boost mode.


### Battery Indicator (Green/Amber)

The Battery Indicator illuminates to indicate the UPS is operating on battery (green) or to signify a battery warning (amber).

### Fault Indicator (Red/Green)

The Fault Indicator illuminates when the UPS detects a problem: red for an internal UPS fault, green for overload and over-temperature conditions.

### Location and Status of Indicators

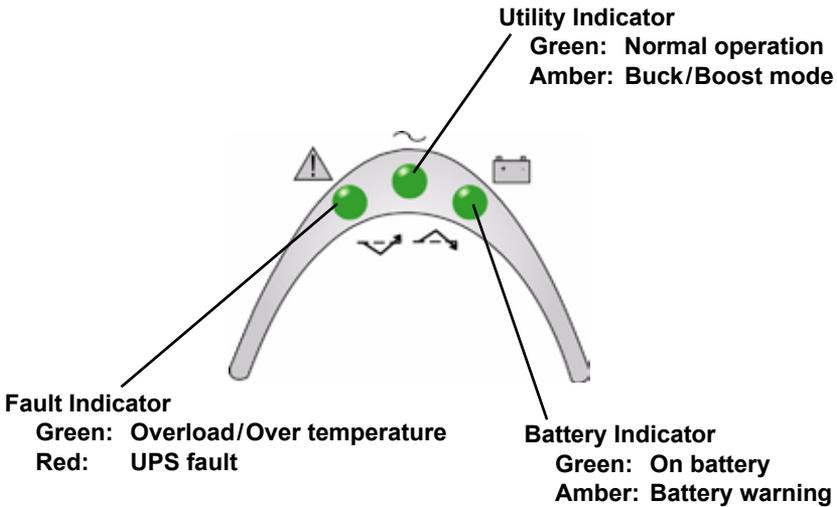


### NOTE

See **Troubleshooting** section for details.

## Site Wiring Fault Indicator (Red)

The Site Wiring Fault Indicator on the rear panel, as shown below, illuminates red when the UPS detects a line-neutral reversal or a poor neutral-ground. (Refer to **Troubleshooting Chart** if this indicator is illuminated.)

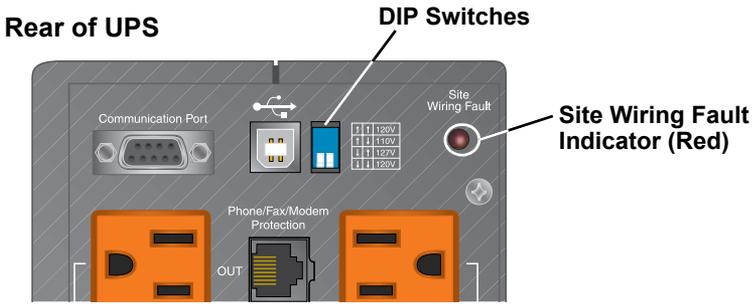

## Transfer Voltage Selectors (DIP Switches)

The two-position DIP switch control on the rear panel, shown above, allows the operator to select the utility transfer voltage at which the UPS will switch to battery power. DIP switch positions for each voltage setting are as follows:

DIP switch settings			
Left	Right	Nominal utility	Setting
↑ Up	↑ Up	120VAC	85 - 145VAC (default)
↑ Up	↓ Down	110VAC	78 - 138VAC
↓ Down	↑ Up	127VAC	90 - 150VAC
↓ Down	↓ Down	120VAC	85 - 145VAC



### CAUTION

Never change the voltage settings while the UPS is ON and powering connected loads. Change DIP switches only when the UPS is OFF.



### CAUTION

To ensure protection of the connected equipment, the DIP switch settings should match the nominal utility input voltage. DIP switch settings not matching the nominal utility could potentially damage connected equipment.


---

## MODES OF OPERATION

---

### Normal Mode

During Normal mode operation, the PowerSure PSA supplies conditioned, computer-grade power to the connected equipment: utility power passes through the TVSS circuitry and the EMI/RFI filters and then through the Bi-Directional Converter to connected equipment. When the UPS is in Normal mode, the Utility Indicator illuminates green.

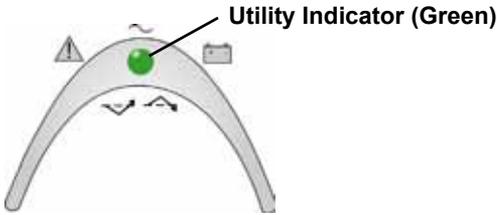


The PowerSure PSA continuously monitors the batteries to maintain them in a fully charged state. The battery charger operates whenever AC power is present, even if the UPS is switched off. By default, the UPS is set to perform an automatic battery test after it has been operating continuously for two (2) weeks. The interval at which the UPS will perform a battery test can be configured via MultiLink.

### Buck/Boost Mode

The Automatic Voltage Regulator (AVR) circuitry compensates for fluctuations in utility power, such as voltage surges and sags. When the PowerSure PSA detects an abnormality, it raises the undervoltage (**boost**) or lowers the overvoltage (**buck**) as needed. The AVR operates automatically and maintains the output voltage to the connected critical equipment, without utilizing the batteries.

When the UPS is in Buck/Boost mode, the Utility Indicator illuminates amber.

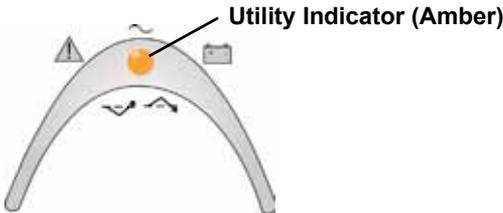


---


## Battery Mode

The UPS switches to Battery mode in the event of an extreme voltage/frequency condition or complete utility failure. The battery system supplies power through the Bi-Directional Converter to generate power for connected equipment.

When the UPS is in Battery mode, the Battery Indicator illuminates green and an alarm sounds every 10 seconds.

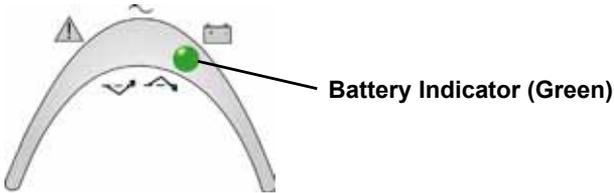

When a low battery condition occurs, the Battery Indicator changes to flashing amber and the alarm sounds every half-second. Low battery warning is defaulted to two (2) minutes but can be configured via MultiLink. For more information, refer to **Troubleshooting** section.

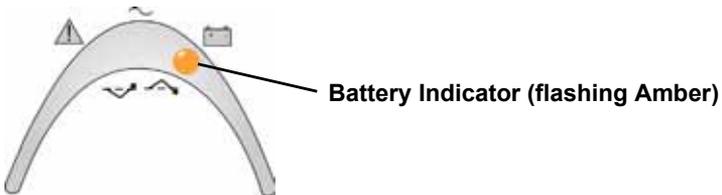

### CAUTION

Turning off the UPS while in either Normal mode or Battery mode will result in the loss of output power.



### NOTE

*Once utility power is restored, the UPS resumes normal operation. At this time, the battery charger begins recharging the battery. The UPS is capable of OFF-State charging, i.e., with utility power, the UPS will charge the batteries as long as it is plugged in.*


# COMMUNICATIONS

## DB-9 Connector

The UPS has a DB-9 (9 pin female) connector on the rear to allow UPS status communications with a computer system running MultiLink™ software. The DB-9 is capable of supplying serial communication, on battery and low battery signals. MultiLink, Liebert's UPS monitoring and shutdown software, is shipped with the UPS, along with a 10 ft. (3m) DB-9 cable required for running MultiLink.

When MultiLink is installed on the host computer, the UPS can signal "on battery" and "low battery" using opto-couplers. When the UPS is operating in Battery mode, it can receive a signal from the host computer system that will shut down the UPS (after gracefully shutting down the operating system on the host computer system) when the remaining battery run time is low. The timing of the signal depends on MultiLink's configuration settings. This shutdown signal (5-12VDC) must have a duration of at least 2 seconds for the UPS to be shut down. The UPS communicates via serial communications using Liebert ESP II protocol.

DB-9 Pin	Assignment Description
1	Low Battery (open collector)
2	UPS TxD (typical RS-232 levels)
3	UPS RxD (typical RS-232 levels)
4	Battery Mode Shutdown (5-12VDC, 10-24 mA max)
5	Common
6	Any Mode Shutdown (short to Pin 5)
7	Low Battery (open emitter)
8	Utility Fail (open emitter)
9	Utility Fail (open collector)

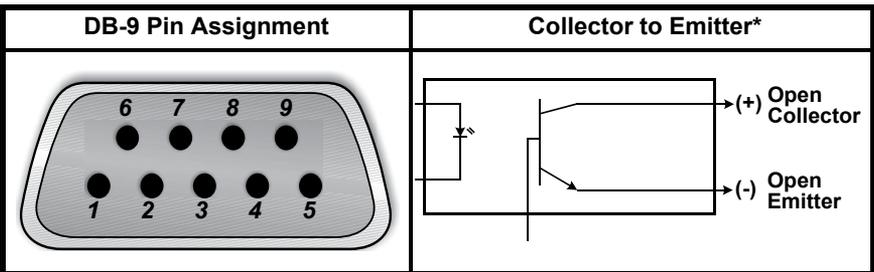

\* Maximum voltage and current on Pins 1, 7, 8, and 9 is 55VDC; 10.0 mA.

---

## Remote Shutdown Via the DB-9 Connector

The PowerSure PSA can be shut down remotely by shorting Pins 5 and 6 or via Pins 4 and 5 of the DB-9 connector.

### Shutdown Via Pins 5 & 6

When Pin 6 is shorted to Pin 5, the UPS output is shut off regardless of what mode the UPS is operating in. The UPS cannot be started as long as the pins are shorted. When the short is removed, the UPS output can be enabled by pressing the ON/OFF/Alarm Silence button.

### Shutdown Via Pins 4 & 5

While the UPS is operating on battery (with no battery test in progress), a 5-12VDC signal for 2 seconds or longer is required to signal a shutdown. Signals for less than 2 seconds are ignored.

After Pin 4 receives the shutdown signal, a 2-minute shutdown timer inside the UPS begins a countdown. The timer cannot be stopped. If utility power returns during the 2-minute timer countdown, the shutdown timer continues until the end of 2 minutes and then the UPS turns off.

By default, autorestart is enabled so the UPS will restart after 10 seconds. If autorestart is disabled via MultiLink software, the UPS remains off until a manual restart.

## USB Interface Port

The PowerSure PSA has a USB interface port for communication that will work with built-in Microsoft Power Manger software on the user's PC, if so equipped. It will provide UPS status and manages the automatic orderly shutdown of the computer. The UPS (USB) communications meets HID standard, version 1.11. All USB models are compatible with Microsoft Windows 2000, Windows XP and Mac OS 10.2 or later. All USB models ship with a 6 ft. (1.8m) USB cable.



Microsoft, Windows, and the Windows logo are trademarks, or registered trademarks of Microsoft Corporation in the United States and/or other countries.

## Data Line Protection Connectors

Data line (IN & OUT) connectors are located on the rear of the UPS and provide transient voltage surge suppression (TVSS) for Phone/Fax/DSL/Internet/Modem devices.

---

## MAINTENANCE

---

The PowerSure PSA UPS requires very little maintenance. Follow these practices to prevent problems.

### Cleaning the UPS

The following will help ensure trouble-free operation for years:

- Vacuum dust from the ventilation intake occasionally.
- Wipe the cover periodically with a dry cloth.

### Maintaining Batteries

The batteries are valve-regulated, nonspillable, lead acid and must be kept charged to retain their design life. The UPS continuously charges the batteries when connected to the utility supply, even while the UPS is switched off.

When storing the UPS, it is recommended to plug in the UPS for at least 24 hours every four to six months to ensure full recharge of the batteries.

### Battery Replacement



#### CAUTION

A battery can present a risk of electrical shock and high short circuit current. The following precautions should be observed before replacing the batteries:

- Remove rings, watches, and other metal objects.
- Do not lay tools or other metal objects on top of the batteries.
- If the battery replacement kit is damaged in any way or shows signs of leakage, contact your local dealer or Liebert representative immediately.
- Do not dispose of batteries in a fire. The batteries may explode.
- Dispose of old batteries according to local codes.

This UPS is equipped with internal “hot swappable” batteries that the user can replace without shutting down the UPS or connected loads.



#### NOTE

*Caution should be exercised when replacing the batteries because the load is unprotected from disturbances and power outages during this procedure.*

---

## Battery Replacement Procedure

Replacement requires removing the battery cover plate on the back or bottom of the UPS. No tools are needed.

To replace the batteries:

1. Remove the battery cover plate on the back/bottom of the UPS (**Figure 1**).
2. Pull the white tabs towards you to remove the battery from the UPS (**Figure 2**).
3. Disconnect the insulated connectors from the battery terminals (**Figure 3**).
4. Insert a new battery pack, and push the connectors onto the battery terminals (black to black & red to red) (**Figure 4**).

Figure 1



Figure 2


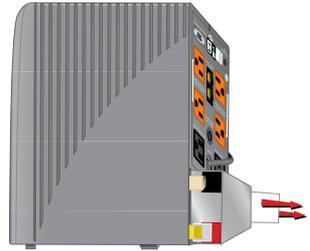


Figure 3



Figure 4

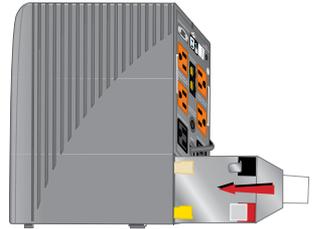

**NOTE: There may be a small spark at the battery terminals when reconnecting the connectors. This is normal and will not harm you or the UPS.**

5. Push the battery pack into the UPS (**Figure 5**).
6. Reattach the battery cover plate (**Figure 6**).

Figure 5




Figure 6



# TROUBLESHOOTING

The information below indicates various symptoms a user may encounter in the event the PowerSure PSA experiences a problem. Use this information to determine whether external factors caused the problem. See **Troubleshooting Chart** for suggested remedy.



1. The Fault indicator illuminates, indicating the UPS detected a problem.
2. An alarm sounds, alerting that the UPS requires attention. The alarm can be silenced except for low battery, overload warning and over-temperature warning conditions.
3. Utility and/or Battery indicators may be illuminated as a diagnostic aid to the operator, as shown below:

## Guide to Status Indicators

Fault Indicator	Utility Indicator	Battery Indicator	Diagnosis/ Audible Alarm
—		—	Normal operation with utility power present; no beep.
—	—		UPS is operating on battery; beep every 10 seconds.
—	—		Battery test has been initiated; no beep.
—		—	UPS is operating in Buck/Boost mode; no beep.
—			Battery needs to be replaced; long beep every minute.
—	—		Low battery warning; beep every half-second.
		—	Overload warning, load is >100%; beep every half-second.
	—	—	Overload shutdown, load exceeds UPS capacity (110%); continuous beep.
		—	Over temperature (overtemp) warning; beep every 5 seconds (Normal mode).
	—		Over temperature (overtemp) warning; beep every 5 seconds (Battery mode).
	—	—	Over temperature (overtemp) shutdown; long beep every 5 seconds.
		—	UPS is on, fault warning; continuous beep.
	—	—	UPS has failed & shut down; continuous beep.

## Troubleshooting Chart

If the UPS fails to operate properly, turn off the unit and repeat the steps in the **Installation** section of this manual. If the problem persists, refer to the chart below:

Problem	Cause	Solution
<b>UPS will not start</b>	Overload/ Short circuit	Check the circuit protector on the rear of the UPS. If it is tripped, reset it and restart the UPS. For further help, call your local dealer, Liebert representative or the Liebert Worldwide Support Group.
	Battery disconnected or is completely discharged	Check for proper connection of battery or batteries.
<b>UPS starts on battery, but will not switch to AC</b>	UPS not plugged in	Plug in the power cord securely.
	Circuit protector tripped	Reset the circuit protector and restart the UPS.
	Power not available at utility receptacle	Have the utility checked by a qualified electrician.
	Input voltage below threshold	Wait until the voltage rises to an appropriate level or have the utility checked by a qualified electrician.
	AC overvoltage	Wait until voltage lowers to an appropriate level or have the utility checked by a qualified electrician.
<b>UPS shuts down, Fault Indicator Lit</b>	Overload/ Short circuit	Check the circuit protector on the rear of the UPS. If it is tripped, reset it and restart the UPS.
	Internal UPS fault	If the problem persists, disconnect some of the equipment from your UPS—the total wattage of your equipment must not exceed the capacity of the UPS. For further help, call your local dealer, Liebert representative or the Liebert Worldwide Support Group.
	High temp shutdown	Make sure that the UPS is operating in a 32°F to 104°F (0°C to 40°C) environment and that it has adequate ventilation.
	MultiLink shutdown	Consult the MultiLink user manual or contact your LAN administrator.
<b>Site Wiring Fault Indicator illuminated</b>	Line-neutral reversal, Poor ground connection	Have the utility checked by a qualified electrician.
<b>UPS not providing expected back-up time</b>	Overload	Reduce load.
	Battery not charged due to a recent outage	Recharge battery.
	Battery needs to be replaced	Replace battery.

# SPECIFICATIONS

Model Number	PSA350MT-120	PSA500MT-120	PSA650MT-120	PSA1000MT-120
<b>Power Rating VA/W</b>	350VA/210W	500VA/300W	650VA/390W	1000VA/600W
<b>DIMENSIONS: in. (mm)</b>				
Unit WxDxH	4.6x7.7x8.7 (116x196x222)	4.6x7.7x8.7 (116x196x222)	4.6x14.1x8.7 (116x358x222)	4.6x14.1x8.7 (116x358x222)
Shipping WxDxH	7.7x12.2x11.5 (196x310x293)	7.7x12.2x11.5 (196x310x293)	9.5x19.7x12.4 (242x500x316)	9.5x19.7x12.4 (242x500x316)
<b>WEIGHT: lbs (kg)</b>				
Unit	16.8 (7.6)	17.2 (7.8)	20.7 (9.4)	29.7 (13.5)
Shipping	18.1 (8.2)	18.5 (8.4)	22.9 (10.4)	31.9 (14.5)
<b>INPUT AC PARAMETERS</b>				
Surge Protection	570J			
Voltage Range Without Battery Operation	78VAC - 150VAC, DIP switch selectable (see DIP switch settings on page 13)			
Frequency Range	46.5 - 63.5 Hz ( $\pm 0.1$ Hz)			
Input Power Cord	6 ft. (1.8m) attached, w/ NEMA 5-15 P			
<b>OUTPUT AC PARAMETERS</b>				
Output Receptacles	(4) NEMA 5-15R (orange) Battery backup + surge protection; (2) NEMA 5-15R (black) Surge protection			(6) NEMA 5-15R (orange) Battery backup + surge protection; (2) NEMA 5-15R (black) Surge protection
Voltage (Normal mode)	Nominal (110, 120, 127VAC) $\pm 10\%$			
Voltage (Battery mode)	120VAC $\pm 8\%$			
Output Current	2.9 A	4.2 A	5.4 A	8.3 A
Waveform (Battery mode)	Stepped Sinewave			
Frequency	50 Hz or 60 Hz; auto sensing			
Overload Warning (Normal & Battery modes)	>100%			
Overload Shutdown	>110%			
<b>BATTERY PARAMETERS</b>				
Type	Valve-regulated, nonspillable, lead acid			
QuantityxVoltagexRating	(1)x12Vx7Ah	(1)x12Vx9Ah	(1)x12Vx9Ah	(2)x12Vx7.5Ah
Transfer Time	4 - 6 ms typical			
Backup Time:	At 77°F (25°C), resistive loading, with fully charged batteries:			
Full Load	8 minutes	8 minutes	5 minutes	5 minutes
Half Load	26 minutes	24 minutes	16 minutes	18 minutes
Recharge Time	6 hours to 90% of rated capacity, after full discharge into resistive load			
<b>ENVIRONMENTAL</b>				
Operating Temperature	+32°F to +104°F (0°C to +40°C)			
Storage Temperature	+5°F to +104°F (-15°C to +40°C)			
Relative Humidity	0% to 95%, non-condensing			
Operating Elevation	Up to 10,000 ft. (3000m) at 86°F (30°C) without derating			
Audible Noise	< 40 dBA, at 1 meter			

AGENCY	
Safety	UL 1778, c-UL Listed
Surge	ANSI C62.41, Category A, Level 3 (IEEE 587, Category A); EN61000-4-5, Level 3, Criteria A
ESD	EN61000-4-2, Level 3, Criteria A
Susceptibility	EN61000-4-3, Level 3, Criteria A
Electrical Fast Transient/Burst	EN61000-4-4, Level 4, Criteria A
Emissions	FCC Part 15, Subpart B, Class B
Conducted Immunity	EN61000-4-6, Level 3, Criteria A
Harmonics	EN61000-3-2
Flicker	EN61000-3-3
Transportation	ISTA Procedure 1A

## Battery Run Times

Load %	350VA	500VA	650VA	1000VA
10	139	128	93	103
20	72	58	39	47
30	45	41	30	34
40	34	28	21	23
50	26	24	16	18
60	19	17	11	13
70	15	15	10	10
80	12	11	8	8
90	10	10	7	7
100	8	8	5	5



### NOTE

*Approximate discharge times are in minutes and at 77°F (25°C) with a resistive load.*

## Product Warranty Registration

To register for warranty protection:

- Visit the **Quick Links** section of our Web site at:  
<http://www.liebert.com>
- Click on **Product Warranty Registration** and fill in the form.

If you have any questions, please contact us at:

US: 800-222-5877

Outside the US: 614-841-6755

[upstech@liebert.com](mailto:upstech@liebert.com)



**DISCONTINUED  
PRODUCT**



## POWER AVAILABILITY

# PowerSure™ PSA

## USER MANUAL

### The Company Behind the Products

With over a million installations around the globe, Liebert is the world leader in computer protection systems. Since its founding in 1965, Liebert has developed a complete range of support and protection systems for sensitive electronics:

- Environmental systems—close-control air conditioning from 1 to 60 tons
- Power conditioning and UPS with power ranges from 300 VA to more than 1000 kVA
- Integrated systems that provide both environmental and power protection in a single, flexible package
- Monitoring and control—from systems of any size or location, on-site or remote
- Service and support through more than 100 service centers around the world and a 24/7 Customer Response Center

While every precaution has been taken to ensure the accuracy and completeness of this literature, Liebert Corporation assumes no responsibility and disclaims all liability for damages resulting from use of this information or for any errors or omissions.

© 2003 Liebert Corporation

All rights reserved throughout the world. Specifications subject to change without notice.

® Liebert and the Liebert logo are registered trademarks of Liebert Corporation. All names referred to are trademarks or registered trademarks of their respective owners.

SL-23270 (3/03) Rev. 1

### Technical Support/Service

#### Web Site

[www.liebert.com](http://www.liebert.com)

#### Monitoring

800-222-5877

[monitoring@liebert.com](mailto:monitoring@liebert.com)

Outside the US: 614-841-6755

#### Single-Phase UPS

800-222-5877

[upstech@liebert.com](mailto:upstech@liebert.com)

Outside the US: 614-841-6755

#### Three-Phase UPS

800-543-2378

[powertech@liebert.com](mailto:powertech@liebert.com)

#### Environmental Systems

800-543-2778

#### Outside the United States

614-888-0246

#### Locations

##### United States

1050 Dearborn Drive

P.O. Box 29186

Columbus, OH 43229

##### Italy

Via Leonardo Da Vinci 8

Zona Industriale Tognana

35028 Piove Di Sacco (PD)

+39 049 9719 111

Fax: +39 049 5841 257

##### Asia

23F, Allied Kajima Bldg.

138 Gloucester Road

Wanchai

Hong Kong

+852 2 572 2201

Fax: +852 2 831 0114



**EMERSON**  
Network Power

DISCONTINUED  
PRODUCT